


SERVICE ENTRANCE CONDUCTORS SHALL PROJECT AT LEAST 5 FT FROM WEATHERHEAD FOR CONNECTION BY COMPANY TO SERVICE DROP. (IDENTIFY NEUTRAL)

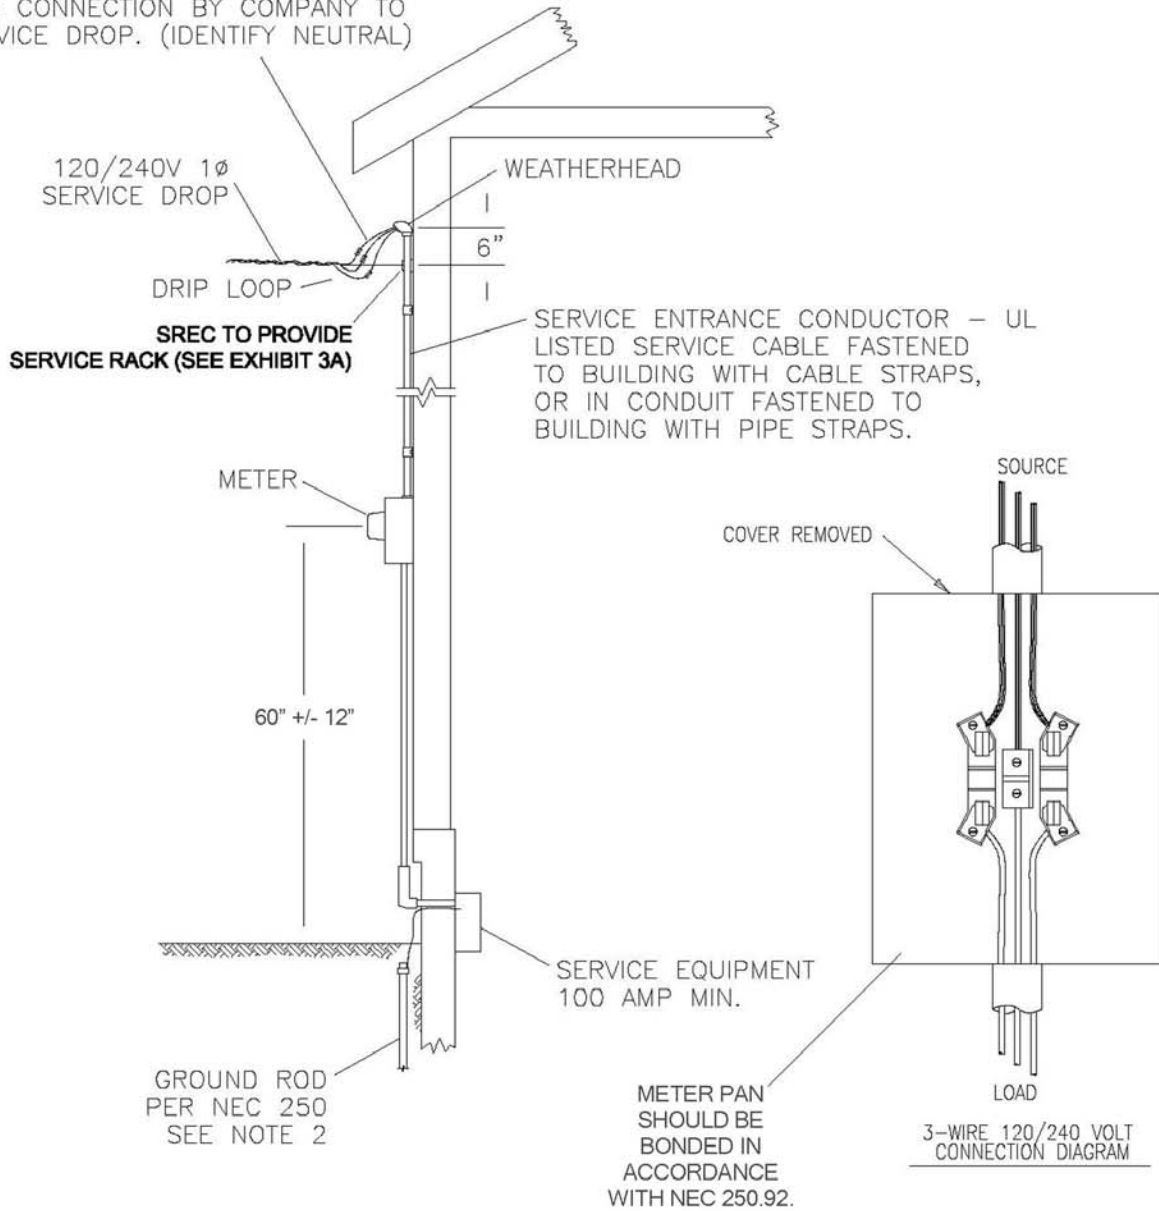

**NOTES:**

1. SERVICE DROP CLEARANCES ABOVE GRADE, ALLEYS, DRIVEWAYS, AND AREAS SUBJECT TO TRUCK USE, SHALL BE IN ACCORDANCE WITH NESC. MINIMUM GROUND CLEARANCE OF 10 FT TO THE BOTTOM OF THE DRIP LOOP IS REQUIRED AS PER NEC.
2. MINIMUM GROUNDING REQUIREMENTS PER NEC 250. METER SOCKET(S) MAY BE CONNECTED TO AN EXTERNAL GROUND ROD IF REQUIRED BY LOCAL INSPECTION AUTHORITIES.
3. FOR CUSTOMER/ COMPANY RESPONSIBILITIES SEE COMPANY SPECIFIC SERVICE GUIDE EXHIBIT 19.

SUSSEX RURAL ELECTRIC COOPERATIVE



84 County Route 639  
Sussex, New Jersey 07461

**OVERHEAD SERVICE  
RESIDENTIAL ENTRANCE  
INSTALLATION**

**Service Guide**

**EXHIBIT 3**

Rev.

1

Date

6/07